

**CURB BOX AND SERVICE CONNECTION**

SCALE: N.T.S.




**CURB BOX AND SERVICE CONNECTION**

**CITY OF POUGHKEEPSIE  
ENGINEERING DEPARTMENT**  
62 CIVIC CENTER PLAZA  
POUGHKEEPSIE, NY 12601

**1**

PAGE NO.

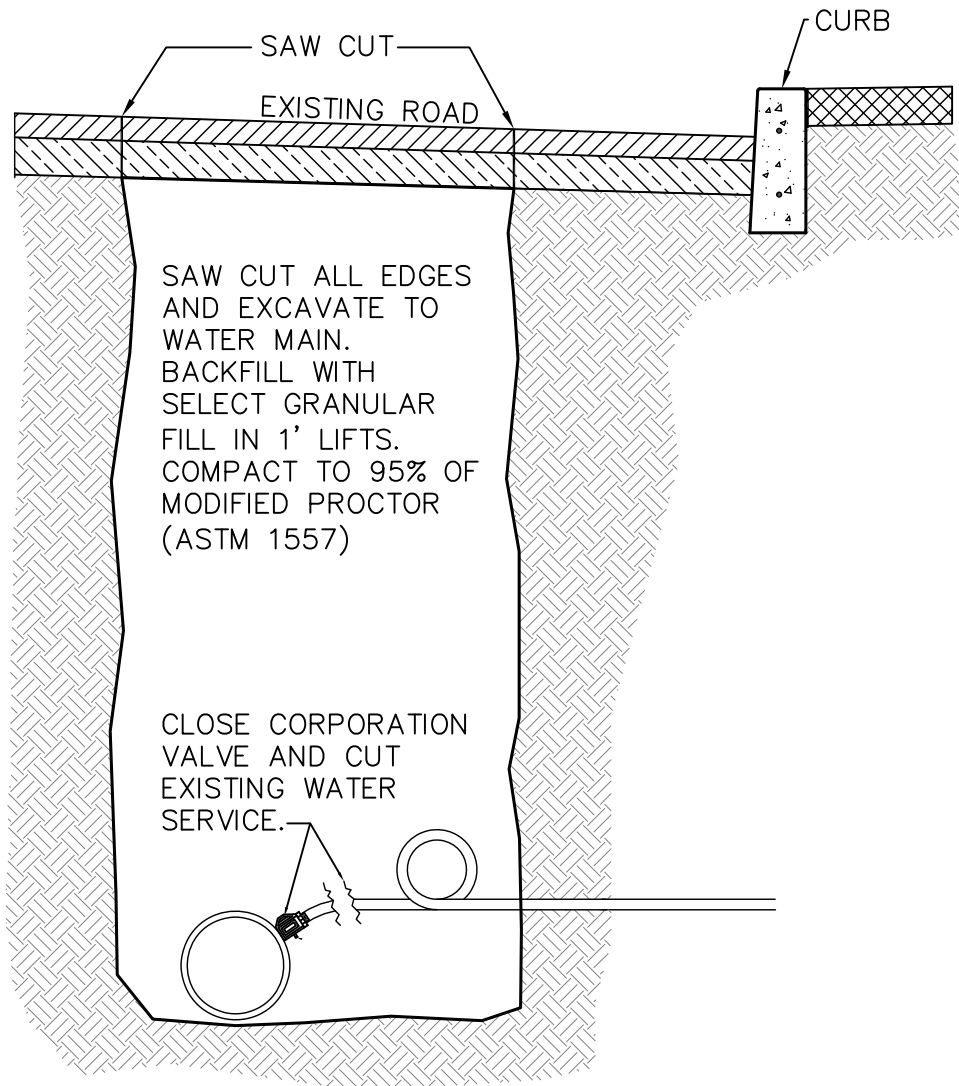

## WATER SERVICE DISCONNECT AT MAIN

SCALE: N.T.S.

**CITY OF POUGHKEEPSIE**  
**ENGINEERING DEPARTMENT**



62 CIVIC CENTER PLAZA  
POUGHKEEPSIE, NY 12601

PROJECT: LSRP  
DATE: 10-30-2018  
SCALE: NTS  
DRAWN BY: JAC

WATER  
DISCONNECT  
AT MAIN

**3**

PAGE NO.

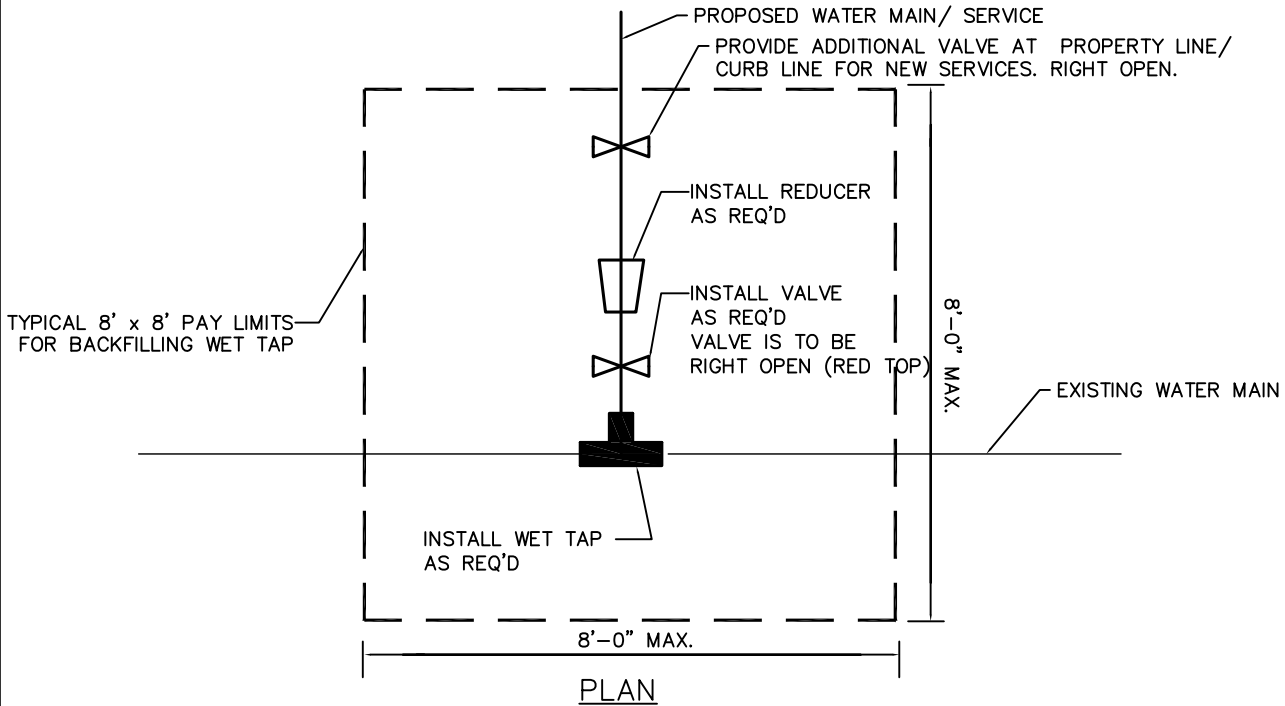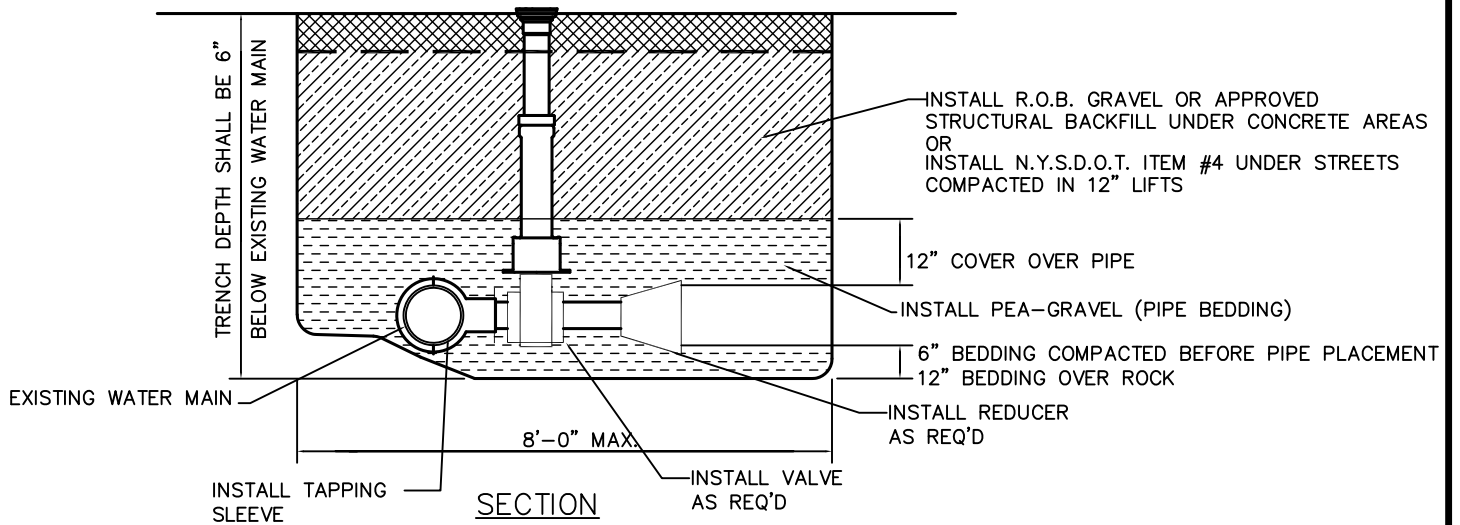

NOTE: ALL BACKFILL TO BE PLACED IN 1' LIFTS AND COMPACTED TO 95% OF MODIFIED PROCTOR (ASTM 1557)

## TAPPING SLEEVE & VALVE


SCALE: N.T.S.



CITY OF POUGHKEEPSIE  
 ENGINEERING DEPARTMENT  
 62 CIVIC CENTER PLAZA  
 POUGHKEEPSIE, NY 12601

TAPPING  
 SLEEVE &  
 VALVE

DATE:  
 9/15/2014

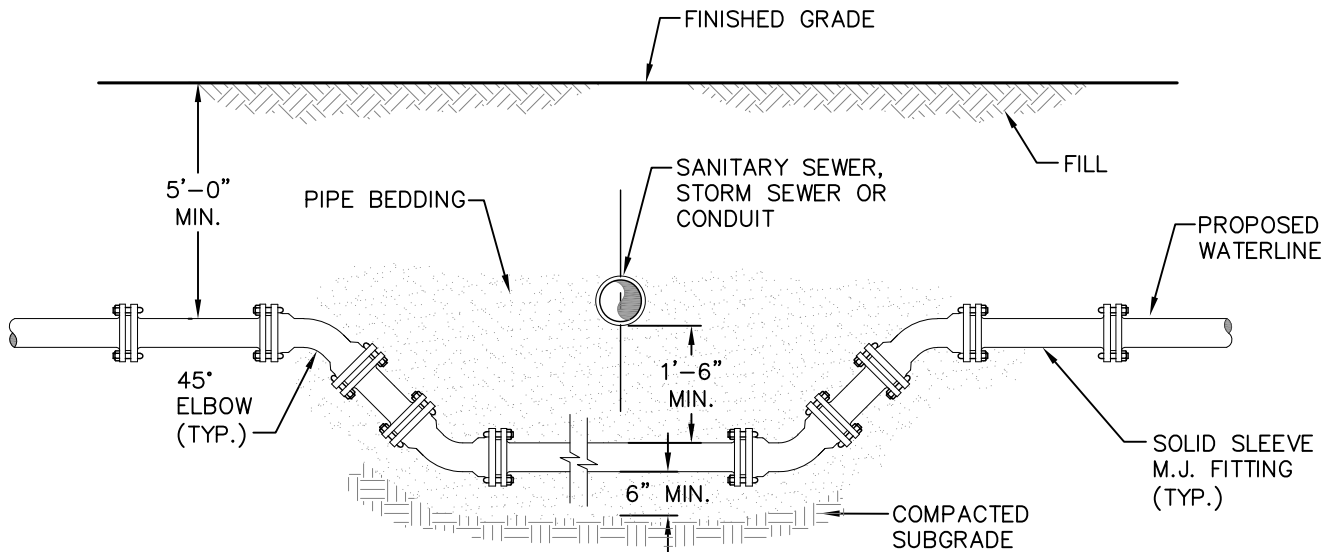

**NOTES:**

1. WHEN THE ELEVATION OF THE SEWER CAN NOT BE VARIED TO MEET THE ABOVE REQUIREMENTS, THE WATERMAIN SHALL BE RELOCATED TO PROVIDE THIS REQUIRED SEPARATION OR RECONSTRUCTED WITH MECHANICAL JOINT PIPE FOR A DISTANCE OF TEN (10) FEET ON EACH SIDE OF THE SEWER. ONE FULL, UN-CUT LENGTH OF WATERMAIN SHALL BE CENTERED OVER THE SEWER SO THAT BOTH JOINTS WILL BE AS FAR AWAY FROM THE SEWER AS POSSIBLE.
2. WHEN IT IS IMPOSSIBLE TO OBTAIN VERTICAL SEPARATION AS STIPULATED ABOVE, BOTH THE WATERMAIN AND THE SEWERMAIN SHALL BE CONSTRUCTED OF SLIP ON OR OF MECHANICAL PIPE JOINTS, CAST IRON PIPE OR SDR 26 PVC COMPLYING WITH PUBLIC WATER SUPPLY DESIGN STANDARDS OF THE AGENCY AND BE PRESSURE TESTED TO 150 PSI TO ASSURE WATER TIGHTNESS.

**WATERLINE OFFSET DETAIL**

SCALE: N.T.S.

CITY OF POUGHKEEPSIE  
 ENGINEERING DEPARTMENT  
 62 CIVIC CENTER PLAZA  
 POUGHKEEPSIE, NY 12601

FILE NO.: 001-DET  
 DATE: 3-6-00  
 SCALE: AS NOTED  
 DRAWN BY: JP

WATERLINE  
 OFFSET

**1**

PAGE NO.